

Myo-D positive control ChIP primer pair ab269261

画像数 3

製品の概要

製品名	Myo-D positive control ChIP primer pair
特記事項	<p>Positive control ChIP-qPCR 5' and 3' primers for Myo-D gene. Use with SYBR green.</p> <p>We recommend these primers as a positive control (based on Abcam's testing) for the histone marks below. They may also be useful for other histone marks.</p> <p>Suitable positive control for:</p> <ul style="list-style-type: none"> - Histone H3 tri methyl K27 - unmodified Histone H3 - Histone H3 mono methyl K4 - unmodified Histone H2B - unmodified Histone H4 - Histone H3 mono methyl K9 - Histone H4 mono methyl K20 - unmodified Histone H2A <p>500pmole of each oligo per unit (lyophilised). HPLC purified, desalted and lyophilised as a sodium salt.</p> <p>Quantity provided is sufficient for approx. 200 reactions based on 2.5pmol of primer per reaction with a final concentration of 100nM in 25µl.</p> <p>Please contact us after purchase if you require the sequence of the oligos.</p>
アプリケーション	適用あり: ChIP

製品の特性

製品の状態	Lyophilized
保存方法	Store at +4°C short term (1-2 weeks). Upon delivery aliquot. Store at -20°C long term. Avoid freeze / thaw cycle.
機能	Involved in muscle differentiation (myogenic factor). Induces fibroblasts to differentiate into myoblasts. Activates muscle-specific promoters. Interacts with and is inhibited by the twist protein. This interaction probably involves the basic domains of both proteins.
配列類似性	Contains 1 basic helix-loop-helix (bHLH) domain.
翻訳後修飾	Acetylated by a complex containing EP300 and PCAF. The acetylation is essential to activate target genes. Conversely, its deacetylation by SIRT1 inhibits its function. Ubiquitinated on the N-terminus; which is required for proteasomal degradation.

アプリケーション


The Abpromise guarantee

Abpromise保証は、次のテスト済みアプリケーションにおけるab269261の使用に適用されます

アプリケーションノートには、推奨の開始希釈率がありますが、適切な希釈率につきましてはご検討ください。


アプリケーション	Abreviews	特記事項
ChIP		Use at an assay dependent concentration.

画像

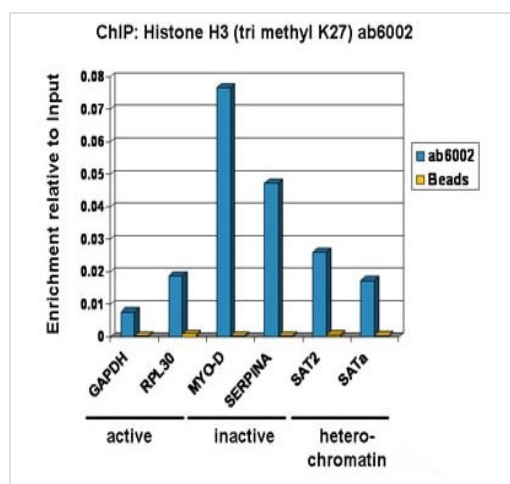


ChIP - Myo-D positive control ChIP primer pair
(ab269261)

Chromatin was prepared from Hela cells according to the **Abcam X-ChIP protocol**. Cells were fixed with formaldehyde for 10 min. The ChIP was performed with 25 µg of chromatin, 5 µg of **ab6002** (blue), and 20 µl of Protein A/G sepharose beads. No antibody was added to the beads control (yellow). The immunoprecipitated DNA was quantified by real time PCR (Taqman approach for active and inactive loci, Sybr green approach for heterochromatic loci). Primers and probes are located in the first kb of the transcribed region.

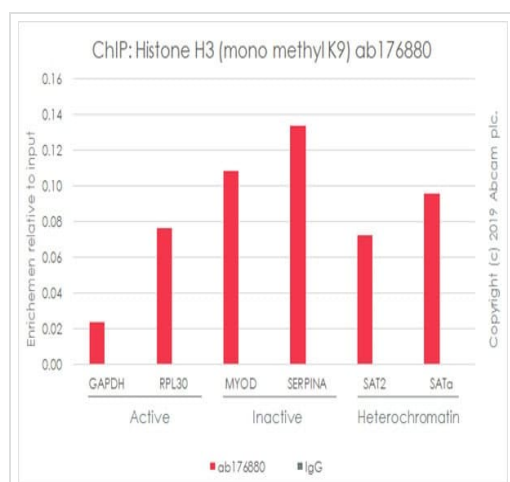

ChIP - Myo-D positive control ChIP primer pair
(ab269261)

Chromatin was prepared from HeLa cells according to the **Abcam X-ChIP protocol**. Cells were fixed with formaldehyde for 10 minutes. The ChIP was performed with 25µg of chromatin, 2µg of **ab176880** (red), and 20µl of Protein A/G sepharose beads. Rabbit normal IgG was added to the beads control (grey). The immunoprecipitated DNA was quantified by real time PCR (Taqman approach for active and inactive loci, Sybr green approach for heterochromatic loci). Primers and probes are located in the first kb of the transcribed region.

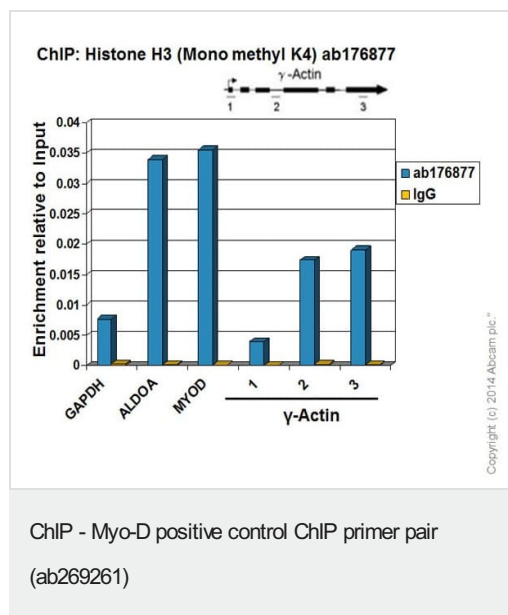

Chromatin was prepared from HeLa (Human epithelial cell line from cervix adenocarcinoma) cells according to the **Abcam X-ChIP protocol**. Cells were fixed with 0.75% formaldehyde for 10min. The ChIP was performed with 25 μ g of chromatin, 2 μ g of **ab176877** (blue), and 20 μ l of Anti-rabbit IgG agarose beads. Rabbit normal IgG was added to the beads control (yellow). The immunoprecipitated DNA was quantified on the GAPDH and ALDOA (active) and MYO-D (inactive) promoters and over the γ -Actin gene (active). Schematic diagram of the γ -Actin gene is shown on the top of the figure. Black boxes represent exons and thin lines represent introns. PCR products are depicted as bars under the gene.

Please note: All products are "FOR RESEARCH USE ONLY. NOT FOR USE IN DIAGNOSTIC PROCEDURES"

Our Abpromise to you: Quality guaranteed and expert technical support

- Replacement or refund for products not performing as stated on the datasheet
- Valid for 12 months from date of delivery
- Response to your inquiry within 24 hours
- We provide support in Chinese, English, French, German, Japanese and Spanish
- Extensive multi-media technical resources to help you
- We investigate all quality concerns to ensure our products perform to the highest standards

If the product does not perform as described on this datasheet, we will offer a refund or replacement. For full details of the Abpromise, please visit <https://www.abcam.co.jp/abpromise> or contact our technical team.

Terms and conditions

- Guarantee only valid for products bought direct from Abcam or one of our authorized distributors